




**LARGE PAVILION**

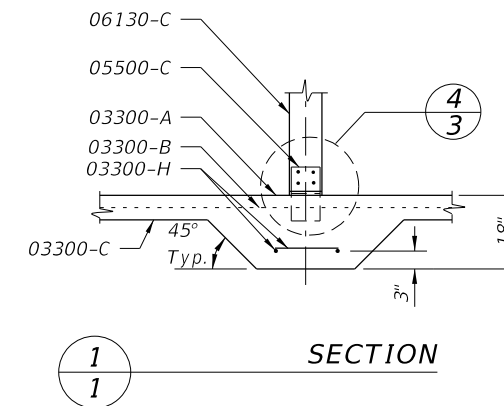


**SECTION 1-1**

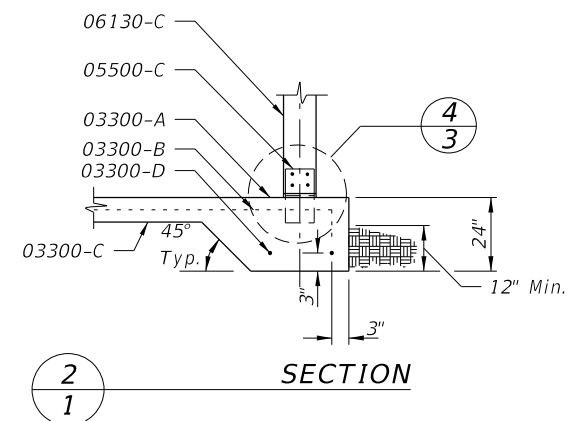

**SECTION 2-1**

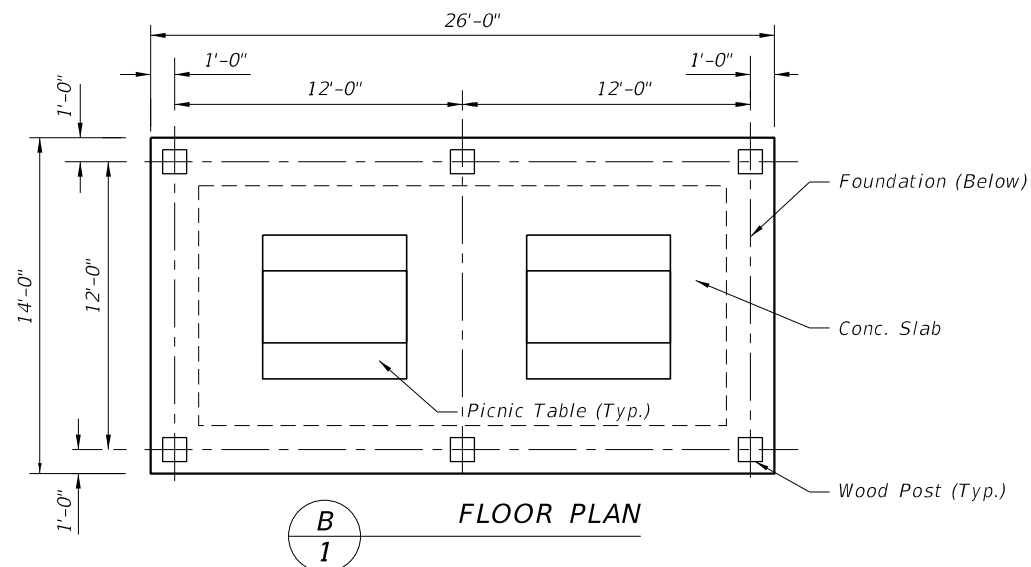

**SMALL PAVILION**

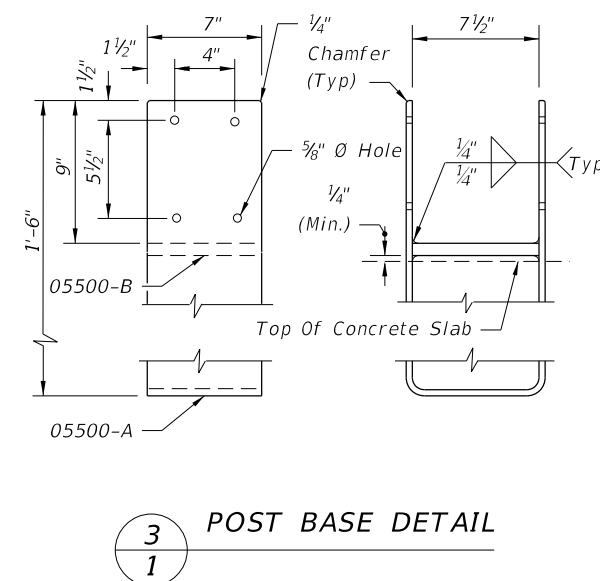

**POST BASE DETAIL 3-1**

**NOTES**

Keynotes on sheet 2.

**FLOOR**

6" reinf. concrete slab  
w/ WWR 6x6-W1.4xW1.4

Drop footing at slab  
perimeter & interior posts see keynotes.

Harden & broom finish slab surface.

**STRUCTURE**

Posts: 8 x 8 PT

Beams: 4 x 6 PT

Framing: 4x PT as described.

Misc members: 1x and 2x as described.

**ROOF**

3"x6" T&G wood decking.

30# asphalt impregnated fiberglass felt  
underlayment.

Standing seam metal roof (24 GA Steel or  
0.032 Alum.) w/ Kynar 500 finish.

Structure, decking and roofing shall be  
designed to withstand 130 mph wind load.

**BUILDING CODE**


Picnic pavilions shall be constructed  
according to the requirements of the  
appropriate sections of the "Florida  
Building Code", current, adopted edition.

**PICNIC TABLES**


Picnic tables and benches shall be 6'x6'  
w/heavy galvanized pipe frames and  
recycled plastic wood seats and table tops.  
All tables shall be of walk thru design  
suitable for exterior locations. Pavilions  
shall meet the requirements of the  
Americans With Disabilities Act (ADA)  
accessibility guidelines. A minimum of 20%  
of picnic tables to meet ADA.

12/31/2015 9:25:03 AM


LAST REVISION 01/01/12	DESCRIPTION:
---------------------------	--------------

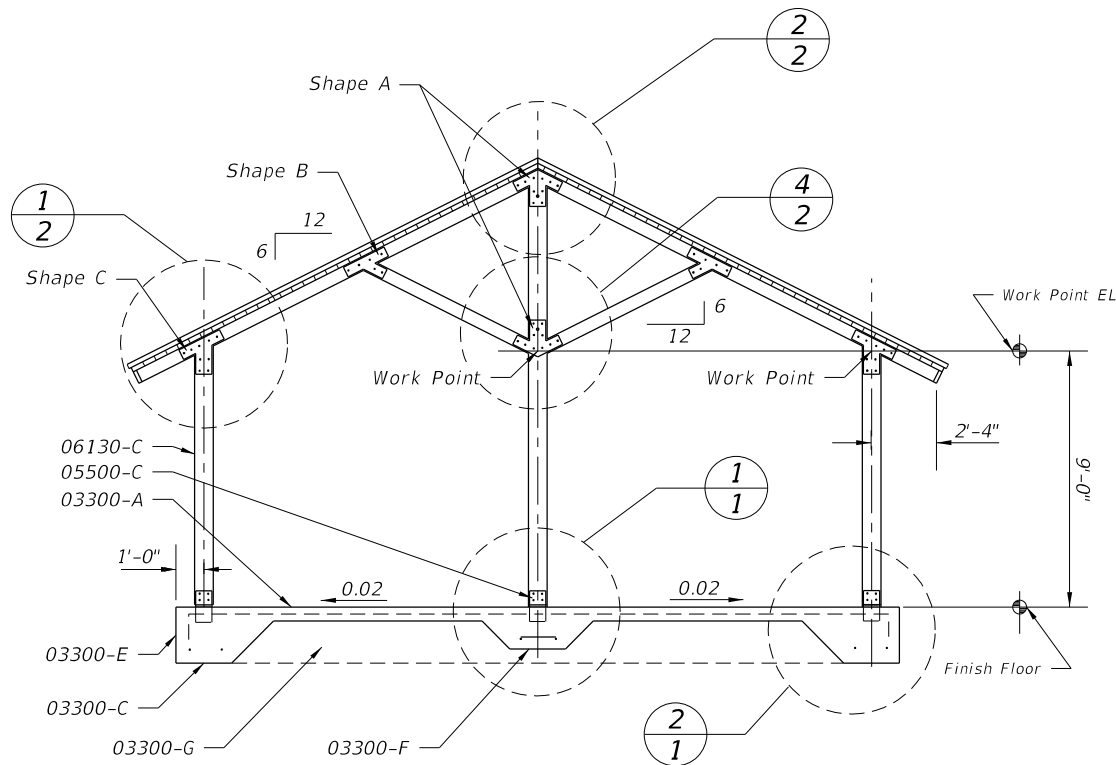


**A** LARGE PAVILION SECTION

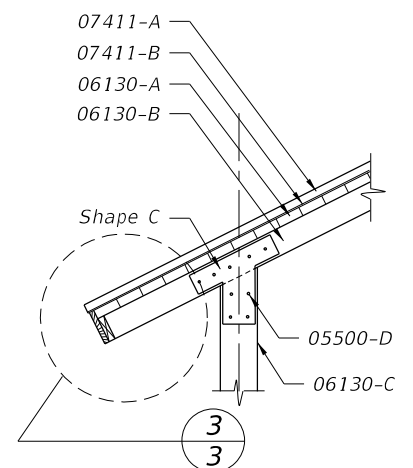


**1** SECTION

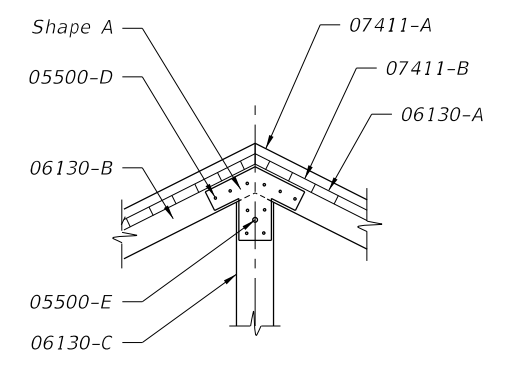


**2** SECTION

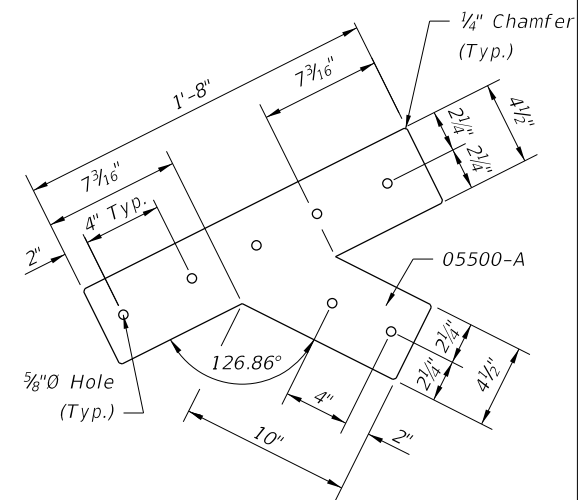


**3** SHAPE B DETAIL

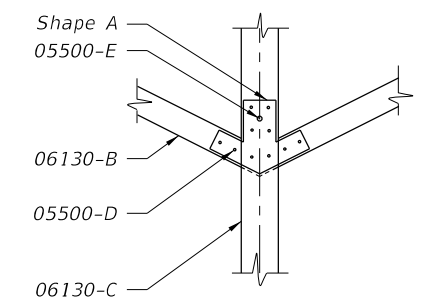


**4** SECTION

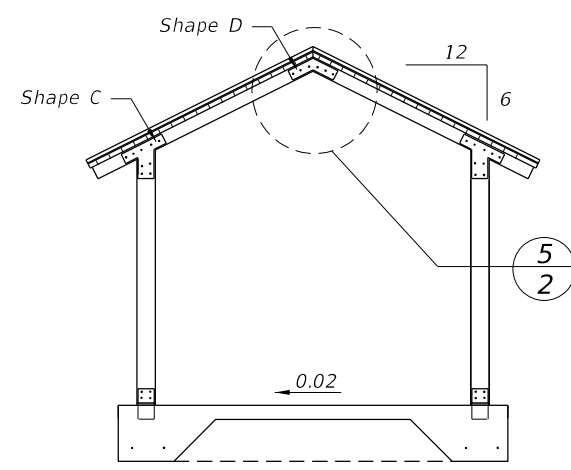


**B** SMALL PAVILION SECTION

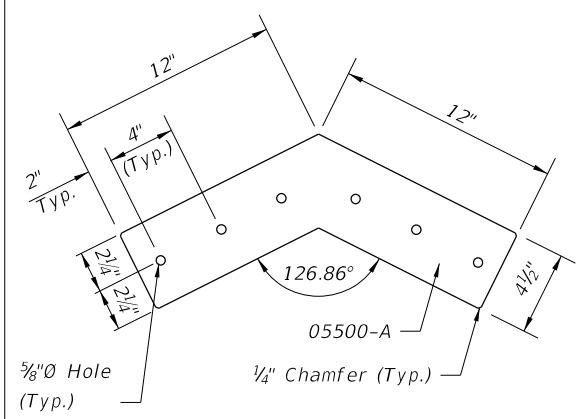

**5** SHAPE D DETAIL

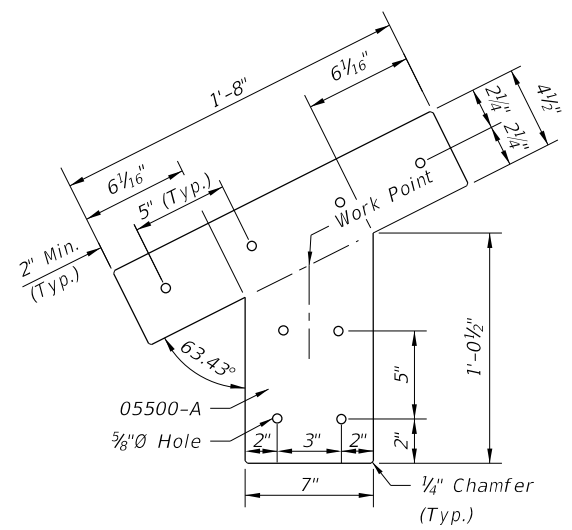

**6** SHAPE C DETAIL

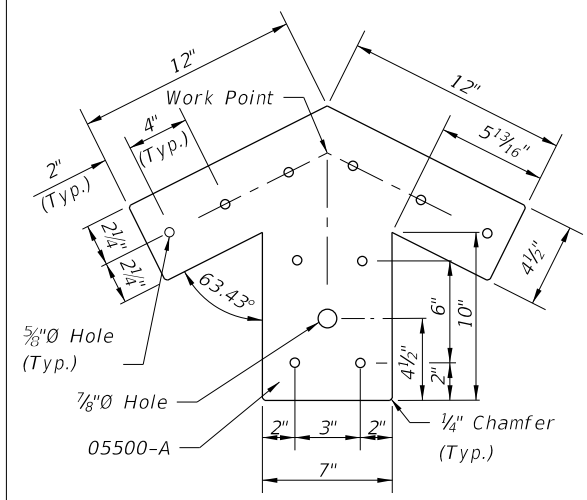


**7** SHAPE A DETAIL


- KEYNOTES**
- 03300-A Class II 6" conc slab
  - 03300-B 6"x6"-W1.4xW1.4 @  $\perp$  of slab
  - 03300-C 6 mil vapor barrier
  - 03300-D #5 rebar cont. (2 required)
  - 03300-E 24" cont. drop footing
  - 03300-F 18"x18" drop footing
  - 03300-G 6" min comp sand fill
  - 03300-H #5x18" rebar (4 required)
  - 05500-A 3/8" galv. steel plate
  - 05500-B 1/2" galv. steel plate
  - 05500-C post base.
  - 05500-D 1/2"  $\emptyset$  bolt, washer & nut (typ.)
  - 05500-E 3/4"  $\emptyset$  eyebolt, washer & nut for cross brace bars
  - 05500-F 1/2"  $\emptyset$  steel rod w/turnbuckle
  - 06130-A 3"x6" T&G wood decking
  - 06130-B 4"x6" PT wood frame
  - 06130-C 8"x8" PT wood post
  - 06130-D 2"x6" PT wood sub fascia
  - 06130-E 1"x10" PT wood fascia
  - 06130-F 3/4"  $\pm$  wood shim
  - 07411-A Standing seam metal roof
  - 07411-B Felt underlayment
- Alternate Material Note: These structures are shown with timber frames and decking. Alternate materials (i.e., aluminum, steel, etc.) may be used when submittals are signed and sealed by a specialty engineer as per Section 5 of the Standard Specifications and when approved by the Engineer.

12/31/2015 9:25:04 AM


LAST REVISION	DESCRIPTION:
01/01/12	

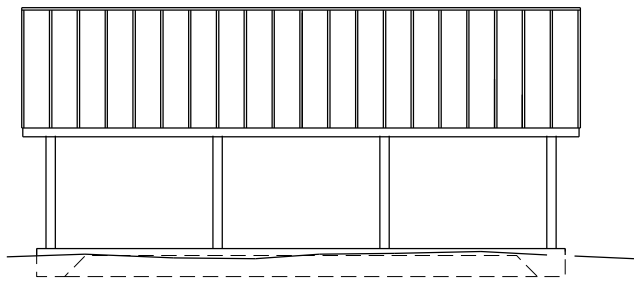


**A**  
3 SIDE ELEVATION

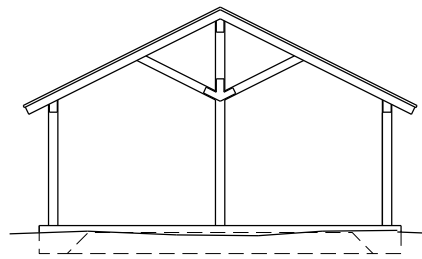


**B**  
3 END ELEVATION

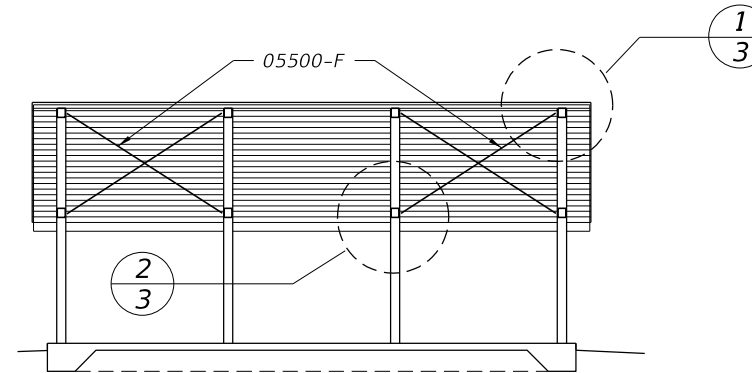


**C**  
3 SECTION

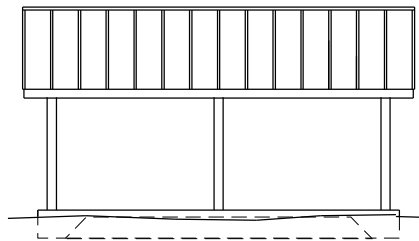


**D**  
3 SIDE ELEVATION

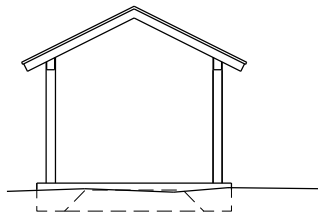


**E**  
3 END ELEVATION

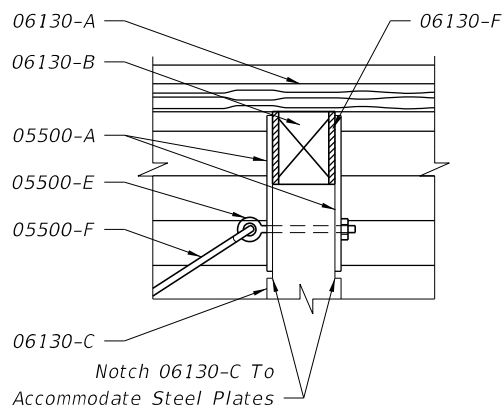


**1**  
3 DETAIL

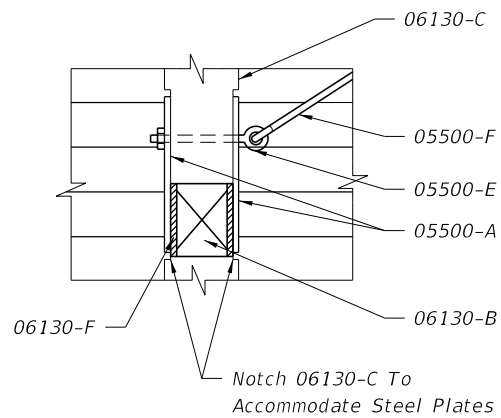

**2**  
3 DETAIL

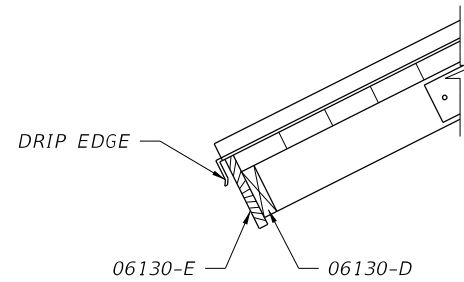

**3**  
3 DETAIL  
Similar At Roof Rake

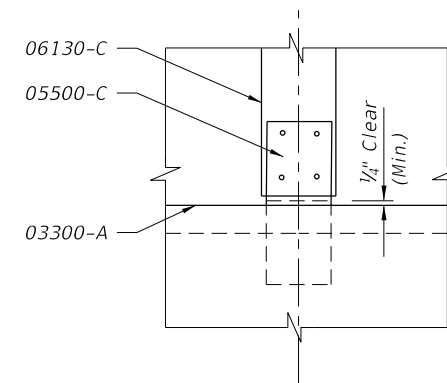

**4**  
3 DETAIL

**SPECIFICATIONS**

Keynotes On Sheet 2.

**CONCRETE**

Concrete: FDOT Class II.

Reinforcing Bars: ASTM A615, Grade 60.

Welded Wire Fabric: ASTM A-185.

Vapor Barrier: Black 6-Mil Polyethylene.

**STEEL**

Galvanized Steel Plate: Steel Plate ASTM A36 or A709.

Provide galvanizing in accordance with the requirements of ASTM A123.

Galvanized Fasteners: High-Strength bolts and nuts, ASTM A325 in accordance with Specification Section 962.

Galvanize shapes after fabrication, make field repairs to galvanizing in accordance with Specification Section 562.

**WOOD**

Comply with American Institute For Timber Construction AITC 108, "Standard For Heavy Timber Construction."

For solid wood decking, comply with AITC 112, "Standard For Tongue And Groove Heavy Timber Standard."

Species: Douglas Fir, Hem-fir, or Southern Pine, at fabricator's option.

Preservative Treatment: Pressure treat fabricated members with waterborne solution for above ground use, complying with AWPA U1, category UC3B above ground exposed.

Wood Decking: Predrill decking at 30" centers for lateral spiking to adjacent units. Spikes to be 8" spikes galvanized common.

12/31/2015 9:25:05 AM

LAST REVISION  
01/01/12

REVISION

DESCRIPTION:



FY 2016-17  
DESIGN STANDARDS

REST AREA PAVILION

INDEX NO.  
530

SHEET NO.  
3 of 3