
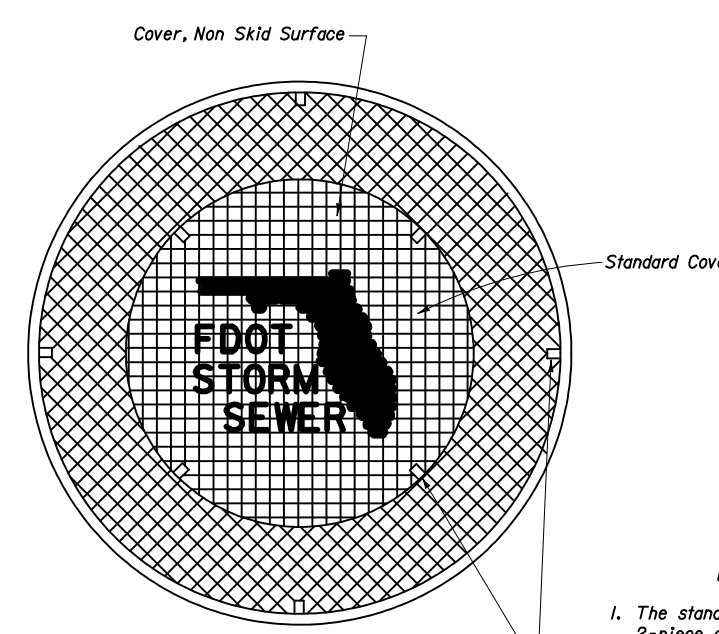



Frame Type	WEIGHT OF CASTINGS					
	2' OPENING		3' OPENING			
	Frame	Cover (Std.)	Frame	2-Piece Cover		
			Inside	Outside	Total	
I	155 Lbs.	190 Lbs.	220 Lbs.	190 Lbs.	220 Lbs.	410 Lbs.
II	145 Lbs.	190 Lbs.	255 Lbs.	190 Lbs.	220 Lbs.	410 Lbs.
III	90 Lbs.	190 Lbs.	180 Lbs.	190 Lbs.	220 Lbs.	410 Lbs.

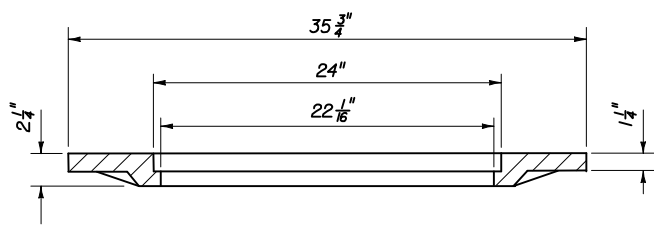

2-PIECE COVER  
CAST IRON FRAMES

NOTES (FRAMES, AND COVER)

- The standard cover is to be used for all frames Types I, II, III and the 2-piece cover, and is the replacement cover for all previous frames with 1 1/2" deep seats (traffic type). The 185 lb. cover (non-traffic type), 1984 Roadway and Traffic Design Standards Index No. 201, is the replacement cover for existing frames with 1/2" deep seats. Installation of frame with 1/2" deep seats is not permitted.
  - Use the 2'-0" cover, unless the 2-piece cover is called for in the plans, except at inlets and manholes with sump bottoms use the 2-piece cover when the sump depth exceeds 2', unless otherwise noted.
- DESIGNER NOTE: Consider using the 2-piece cover where depths exceed 5' and manual entry may be required for cleaning. Clearly note the requirement for a 2-piece cover, on the Drainage Structure sheets in the plans.

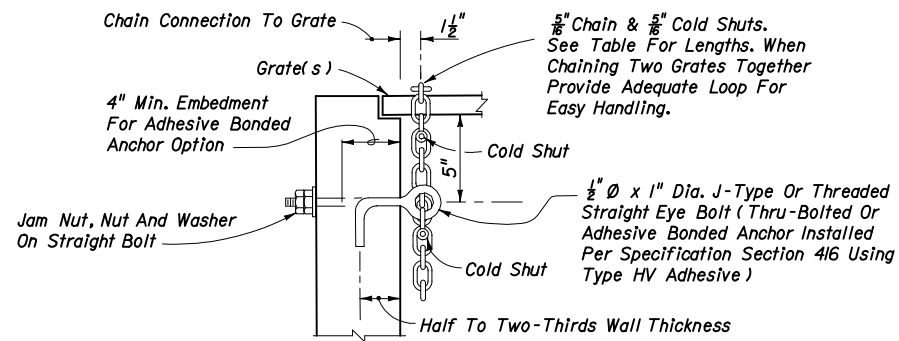


NOTE: When Alternate G grate is specified, the chain, bolt, nuts, washer and cold shuts shall be galvanized in accordance with the specifications for the grate.


Cost of eye bolt and chain to be included in the contract unit price for inlets.

EYE BOLT AND CHAIN REQUIREMENTS					
Index Number	Inlet Type	Eye Bolts	Length Of Chain	Handling & Remarks	
217	(MB) 1	1	4'-0"	Slide & Spin	
	(MB) 2	1	4'-0"	Slide & Spin	
	(MB) 3	2	2 @ 4'-0"	Slide & Spin	
	(MB) 4	2	2 @ 4'-0"	Slide & Spin	
	(MB) 5	2	2 @ 4'-0"	Slide & Spin	
218	(BW)	1	3'-8"	Slide Or Slide & Spin	
219	(BW, RGD)	1	4'-0"	Slide & Spin	
220	S	1	4'-0"	Slide & Spin	
221	V	1	4'-0"	Slide & Spin	
230	A	1	3'-0"	Slide	
	B	1	5'-0"	Slide & Spin	
	232	C	1	2'-6"	Slide & Spin
		D	1	2'-6"	Slide & Spin
		E	2	2 @ 2'-6"	Slide & Spin
233	H	2	2 @ 2'-6"	Flip Ctr. Grate and Slide & Spin Single Free Grate	
			1 or 2 @ 1'-6"	Ctr. Grate(s) Chained To One End Grate	
	F	1	3'-6"	Flip Or Slide & Spin	
234	G	1	6'-0"	Slide	
			2'-0"	Lifting Loop	
	J	1	4'-0"	Slide & Spin	

### EYE BOLT AND CHAIN FOR LOCKING GRATES TO INLETS

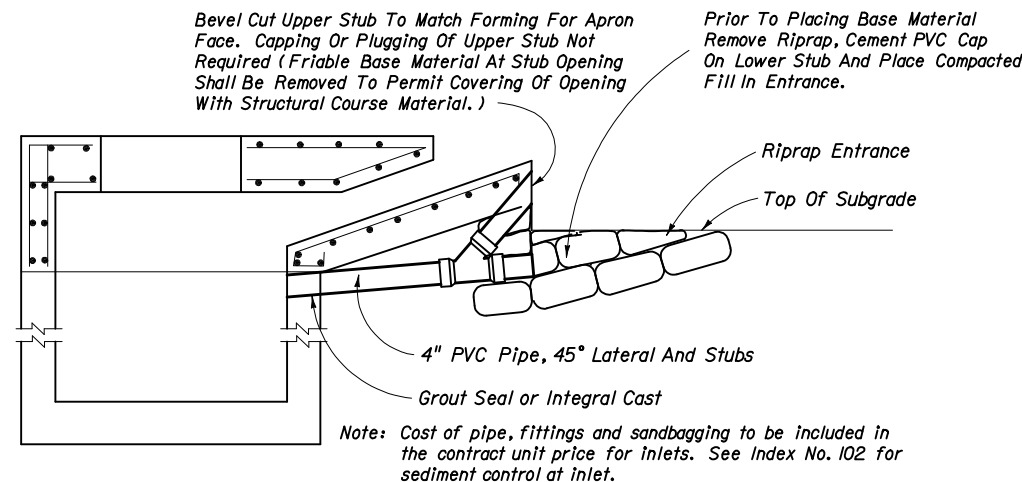

### TEMPORARY DRAINS FOR SUBGRADE AND BASE

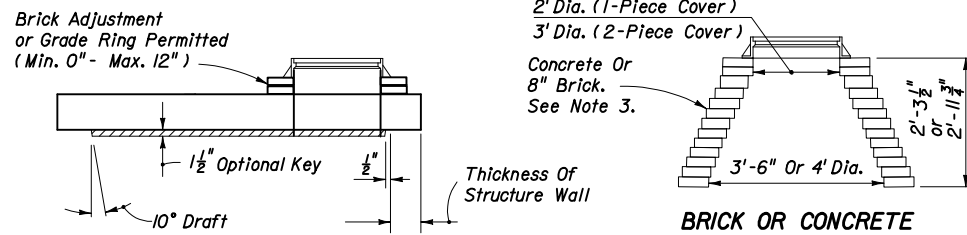

SECTION  
Note: See Slab Designs Index No. 200.

### TYPE 7


## MANHOLE TOPS

### NOTES (TOPS)


- Manhole top Type 7 slabs shall be of Class II concrete. Concrete as specified in ASTM C478 may be used for precast units; see General Note No. 3.
- Manhole top Type 7 slabs may be of cast-in-place or precast construction. The optional key is for precast tops and in lieu of dowels. Frame and slab openings are to be omitted when top is used over a junction box.
- Manhole top Type 8 may be of cast-in-place or precast concrete construction or brick construction. For concrete construction, the concrete and steel reinforcement shall be the same as the supporting wall unit. An eccentric cone may be used.
- Manhole tops shall be secured to structures by optional construction joints as shown on Sheet 3 of 4.
- Frames can be adjusted a maximum 12" height with brick or precast ASTM C478 grade rings.
- Substitution of manhole top Type 8 for manhole top Type 7 is allowed provided that minimum dimensions shown above are not reduced.
- Substitution of Manhole top Type 7 for Type 8 is allowed if the minimum thickness (h) above pipe opening cannot be maintained with manhole top Type 8.

### DESIGN NOTES

- Manhole top Type 8 should be specified in the plans when depths shown above can be maintained.

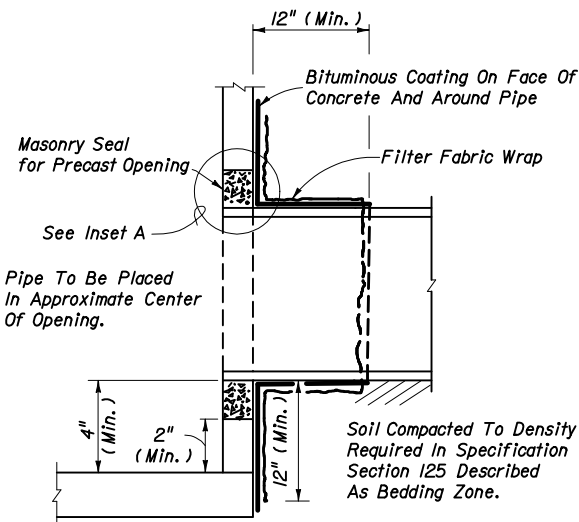


### FILTER FABRIC WRAP ON GROUTED PIPE TO STRUCTURE JOINT

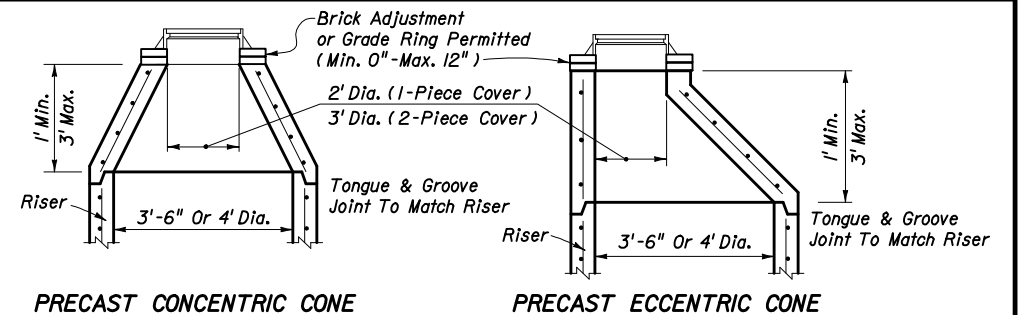

### PRECAST CONCENTRIC CONE


### PRECAST ECCENTRIC CONE

### TYPE 8

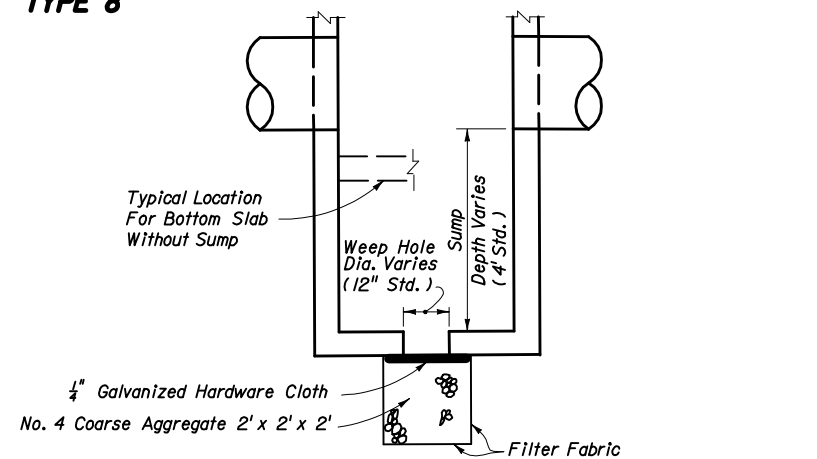


NOTE: Sump bottom appropriate for all manhole and inlet types. Sumps are to be constructed in inlet and manholes connected to French Drains unless excluded in the plans. At other locations, sump is to be constructed only where called for in the plans. Weep holes to be constructed in sump bottom only where called for in the plans. Cost of sump bottom and weep hole to be included in the contract unit price for inlet or manhole.

### SUMP BOTTOM



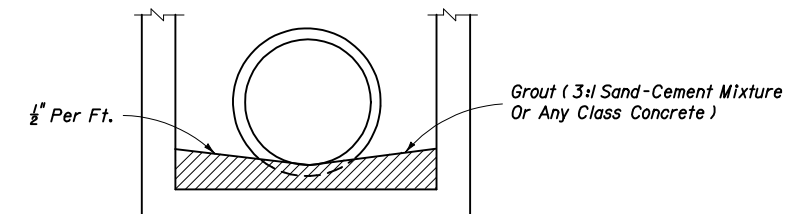


FOR ALL STRUCTURES UNLESS EXCLUDED BY SPECIAL DETAIL

### ALL PIPE TYPES DRAINAGE STRUCTURE INVERT

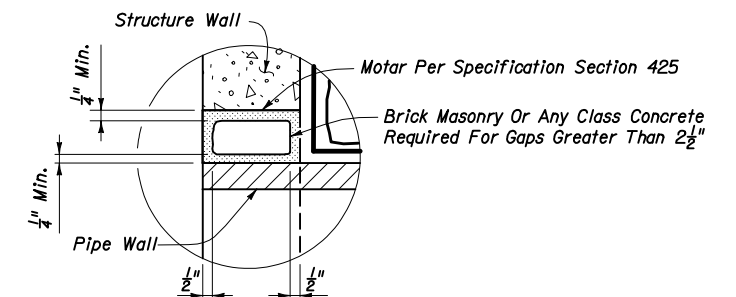


### INSET A

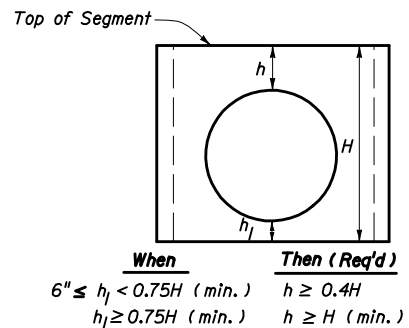


Minimum Value For H	
H (min.)	Box Or Riser Diameter
1'-0"	3'-6" & 4'-0"
1'-6"	5'-0" & 6'-0"
2'-0"	> 6'-0"

Segments may be inverted. Opening for pipe shall be the pipe OD plus 6" ( $\pm 2"$  tolerance). If h can not be attained, then a top or bottom slab must be attached to the segment as shown below.


**SEPARATE RISER SEGMENTS WITH CONSTRUCTION JOINTS OTHER THAN DOWEL OPTION**

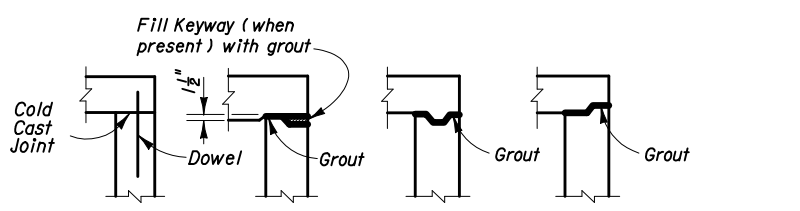

**TOP SLABS TO WALLS**

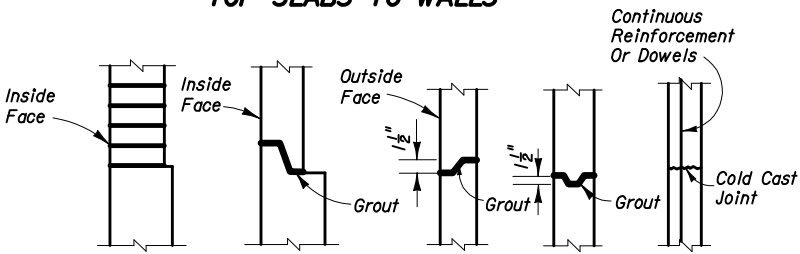


**WALL JOINTS**

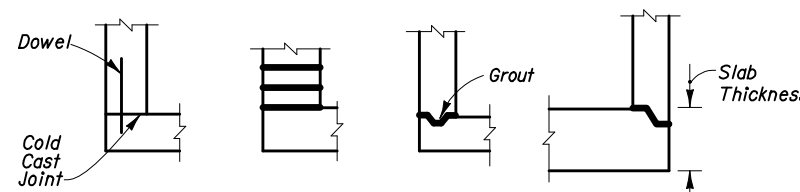

**BOTTOM SLABS TO WALLS**

- One or more types of joints may be used in a single structure, except brick wall structure. Brick wall construction is permitted on circular units only.
- All grouted joints are to have a maximum thickness of 1".
- Keyways are to be a minimum of 1/2" deep.
- Joint dowels are to be #4 bars, 12" long with a minimum of 6 bars per joint approximately evenly spaced for circular structures or at maximum 12" spacing for rectangular structures. Bars may be either Adhesive Bonded Dowels in accordance with Specification Section 416, or placed approximately 6" into fresh concrete leaving the remainder to extend into the secondary cast. Welded wire fabric may be substituted for the dowel bar in accordance with the equivalent steel area table on Sheet 4.
- Minimum cover on dowel reinforcing bars is 2" to outside face of structure.
- Joints between wall segments and between wall segments and top or bottom slabs may be sealed either by preformed plastic gasket material using the procedures given in Section 430-7.3 of the Specifications or by non-shrink grout, in accordance with Section 934 of the Specifications.
- Approved product inserts may be used in lieu of dowel embedment.


**OPTIONAL CONSTRUCTION JOINTS**

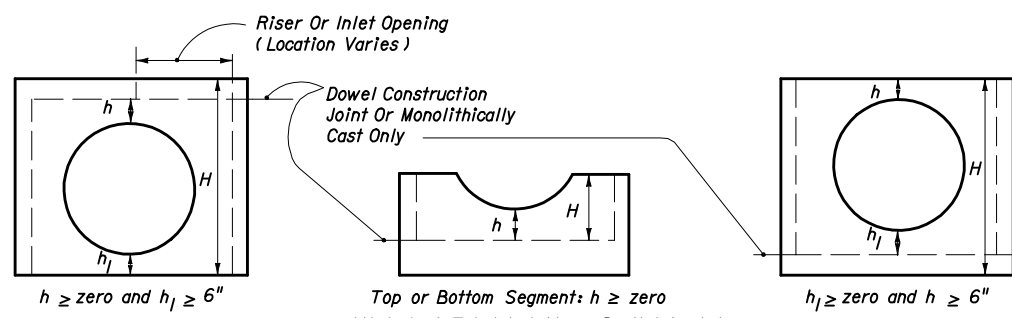

**SEGMENTS FOR SLAB TO WALL DOWEL CONSTRUCTION JOINTS OR MONOLITHICALLY CAST SEGMENTS**

NOTE: h may be less than 6" when approved by the Engineer, but not for inlet segments at finish grade elevation.

**COMPARATIVE SIDE VIEWS**

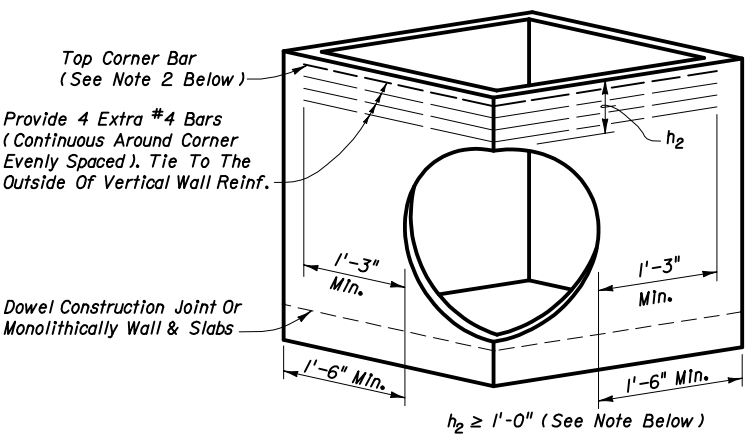

**RECTANGULAR SEGMENT WITH PIPE OPENING AT CORNER**


- NOTE: 1.  $h_2$  may be less than 1'-0" when approved by the Engineer or when a minimum 1'-0" deep segment, 8" slab or curb inlet is provided above the corner opening.
2. For inlet segments at finish grade elevation substitute a #8 Bar for the top corner bar when  $h_2$  is less than 2'-0".

DESIGNER NOTE: Rectangular structures with corner openings are not recommended. Use round structure bottoms when possible.

**PICTORIAL VIEW**


**MINIMUM DIMENSIONS FOR BOX AND RISER SEGMENTS**

The "UTILITY PIPES THRU STORM SEWER STRUCTURES" Details Have Been Moved To Index No. 307 "MISCELLANEOUS UTILITY DETAILS".

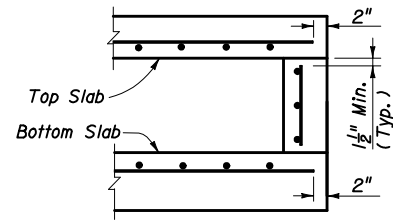

( NOTE: NOT APPLICABLE AROUND MANHOLE AND RISER OPENINGS )

**REBAR STRAIGHT END EMBEDMENT FOR TOP AND BOTTOM SLABS**

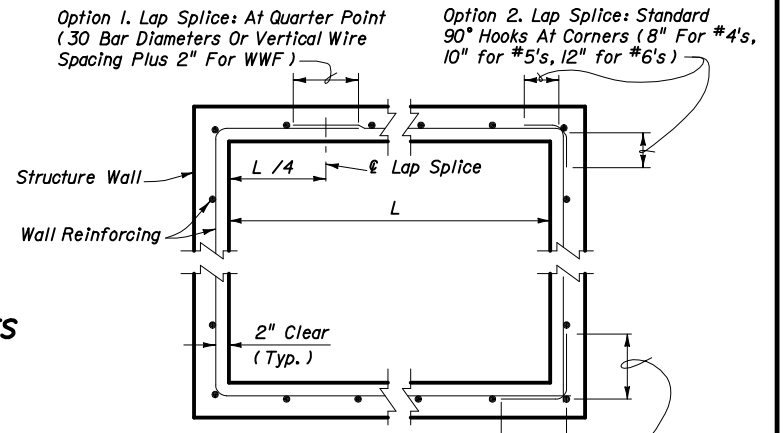

**WALL REINFORCING SPLICE DETAILS**

**GENERAL NOTES**

- For square or rectangular precast drainage structures, either deformed or smooth welded wire fabric may be used provided:
  - The smooth welded wire fabric shall comply with ASTM A185 and deformed welded wire fabric shall comply with ASTM A497.
  - Width and length of the unit is four times the spacing of the cross wires.
  - Wire fabric shall be continuous around the box, and lapped in accordance with Option 1 or 3 as shown above in the Wall Reinforcing Splice Details.
- For equivalent steel areas for precast drainage structures, see Sheet 4.
- Horizontal steel in the walls of rectangular structures shall be lap spliced in accordance with Option 1, 2 or 3 as shown above in the Wall Reinforcing Splice Details.
- Welding of splices and laps is permitted. The requirements and restrictions placed on welding in AASHTO M259 shall apply.
- Rebar straight end embedment of peripheral reinforcement may be used in lieu of ACI standard hooks for top and bottom slabs except when hooks are specifically called for in the plans or standard drawings.
- Concrete as specified in ASTM C478, (4000 psi) may be used in lieu of Class II concrete in precast items manufactured in plants which meet the requirements of Section 449 of the Specifications.
- Precast opening for pipe shall be the pipe OD plus 6" ( $\pm 2"$  tolerance). Mortar used to seal the pipe into the opening will be of such a mix that shrinkage will not cause leakage into or out of the structure. Dry-pack mortar may be used in lieu of brick and mortar construction to seal openings less than 2 1/2" wide.
- For pay item purposes, the height used to determine if a drainage structure is less than or greater than 10 feet shall be computed using (a) the elevation of the top of the manhole lid, (b) the grate elevation or the theoretical gutter grade elevation of an inlet, or (c) the outside top elevation of a junction box less the flow line elevation of the lowest pipe or to top of sump floor.



2006 FDOT Design Standards

**SUPPLEMENTARY DETAILS FOR MANHOLES AND INLETS**

Last Revision	Sheet No.
07/01/05	3 of 4
Index No.	
201	

EQUIVALENT STEEL AREA TABLE						
SCHEDULE	GRADE 60 REINFORCING BAR		EQUIVALENT GRADE 40 REINFORCING BAR		EQUIVALENT 65 KSI & 70 KSI WELDED WIRE FABRIC	
	Bar Size & Spacing	Steel Area (in <sup>2</sup> /ft)	Bar Size & Spacing	Min. Steel Area (in <sup>2</sup> /ft)	Style Designation	Min. Steel Area (in <sup>2</sup> /ft)
A	#3 @ 6 1/2" Ctrs. #4 @ 12" Ctrs.	0.20	#3 @ 4 1/2" Ctrs. #4 @ 8" Ctrs. #5 @ 12" Ctrs.	0.30	3" x 3" - W4.6 x W4.6 4" x 4" - W6.2 x W6.2 6" x 6" - W9.2 x W9.2	0.1846
B	#3 @ 5 1/2" Ctrs. #4 @ 10" Ctrs.	0.24	#3 @ 3 1/2" Ctrs. #4 @ 6 1/2" Ctrs. #5 @ 10" Ctrs.	0.36	3" x 3" - W5.5 x W5.5 4" x 4" - W7.4 x W7.4 6" x 6" - W11.1 x W11.1	0.2215
Special 1	#3 @ 5" Ctrs. #4 @ 9" Ctrs.	0.267	#3 @ 3" Ctrs. #4 @ 6" Ctrs. #5 @ 9" Ctrs.	0.40	3" x 3" - W6.2 x W6.2 4" x 4" - W8.2 x W8.2 6" x 6" - W12.3 x W12.3	0.2465
C	#3 @ 3 1/2" Ctrs. #4 @ 6 1/2" Ctrs. #5 @ 10" Ctrs.	0.37	#4 @ 4" Ctrs. #5 @ 6 1/2" Ctrs. #6 @ 9 1/2" Ctrs.	0.555	3" x 3" - W8.5 x W8.5 4" x 4" - W11.4 x W11.4 6" x 6" - W17.1 x W17.1	0.3415
D	#4 @ 4 1/2" Ctrs. #5 @ 7" Ctrs. #6 @ 10" Ctrs.	0.53	#4 @ 3" Ctrs. #5 @ 4 1/2" Ctrs. #6 @ 6 1/2" Ctrs.	0.795	3" x 3" - W12.2 x W12.2 4" x 4" - W16.3 x W16.3 6" x 6" - W24.5 x W24.5	0.4892
E	#4 @ 3" Ctrs. #5 @ 5" Ctrs. #6 @ 7" Ctrs.	0.73	#5 @ 3 1/2" Ctrs. #6 @ 4 1/2" Ctrs. #7 @ 6 1/2" Ctrs.	1.095	3" x 3" - W16.8 x W16.8 4" x 4" - W22.5 x W22.5 6" x 6" - W33.7 x W33.7	0.6738
F	#5 @ 3 1/2" Ctrs. #6 @ 5" Ctrs. #7 @ 7" Ctrs.	1.06	#6 @ 3" Ctrs. #7 @ 4 1/2" Ctrs. #8 @ 6" Ctrs.	1.59	3" x 3" - W24.5 x W24.5 4" x 4" - W32.6 x W32.6 6" x 6" - W48.9 x W48.9	0.9785
Special 2	#5 @ 3" Ctrs. #6 @ 4" Ctrs. #7 @ 5 1/2" Ctrs.	1.24	#7 @ 4" Ctrs. #8 @ 5" Ctrs.	1.86	3" x 3" - W28.6 x W28.6 4" x 4" - W38.2 x W38.2 6" x 6" - W57.2 x W57.2	1.1446
G	#6 @ 3 1/2" Ctrs. #7 @ 5" Ctrs.	1.46	#7 @ 3" Ctrs. #8 @ 4" Ctrs.	2.19	3" x 3" - W33.7 x W33.7 4" x 4" - W44.9 x W44.9	1.3477

### NOTES FOR PRECAST OPTIONS ≤ 15' DEPTH

- Details for optional precast inlet construction up to depths of 15' are shown on the inlet indexes.
- When precast units are used in conjunction with Alt. "B" Structure Bottoms, Index No. 200, the interior dimensions of an Alt. "B" Bottom can be adjusted to reflect these inlet interior dimensions.
- Concrete which meets the requirements of ASTM C478 or Class IV must be used for precast structures constructed with 6" wall or slab thickness.
- Reinforcement can be either deformed bar reinforcement or welded wire fabric. Bar reinforcement other than 60 ksi may be used, however only two grades are recognized; Grade 40 and Grade 60. Welded wire fabric, including deformed welded wire fabric, will be recognized as having a design strength of 65 ksi. The area of reinforcement required may be adjusted in accordance with the Equivalent Steel Area Table provided. For bars and spacings not given, the steel area required can be determined by the following equation:

$$\text{Grade 40 Steel Area} = A_{S40} = \frac{60}{40} \times A_{S60}$$

$$\text{Welded Wire Fabric Steel Area} = A_{S65-70} = \frac{60}{65} \times A_{S60}$$

In no case will fabric with wires smaller than W3.1 or spacings greater than 8" be permitted. Bar reinforcement shall show the minimum yield designation grade mark or either the number 60 or one (1) grade mark line to be acceptable at the higher value. Maximum bar spacing shall not be greater than two (2) times the slab thickness with a maximum spacing of 12" or three (3) times the wall thickness, with a maximum spacing of 18" for vertical bars and 12" for horizontal bars.

The Precast Inlet Details For Index Nos. 217, 219, 220, 221, 231, 232, 233 And 234 Have Been Moved To Each Of The Referenced Indexes.



2006 FDOT Design Standards

## SUPPLEMENTARY DETAILS FOR MANHOLES AND INLETS

Last Revision	Sheet No.
07/01/05	4 of 4
Index No.	
201	